


### ACCESS ENTRANCE DETAIL

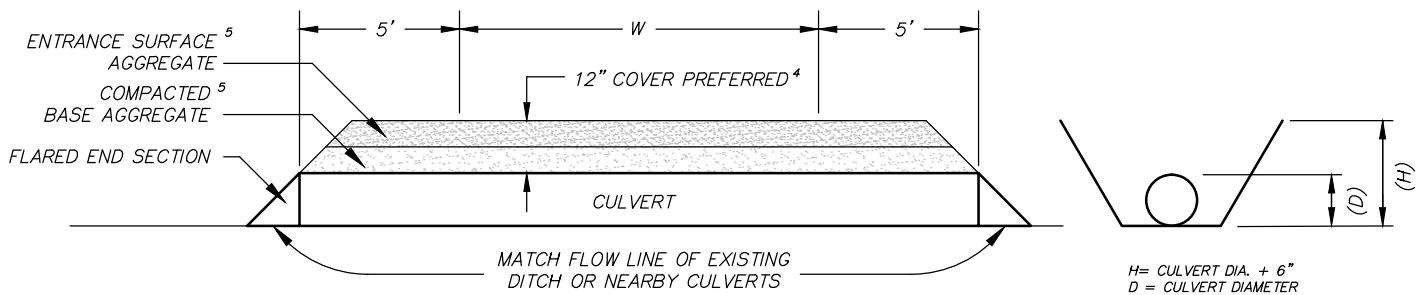

### ACCESS ENTRANCE PROFILE

### CROSS-SECTION OF DITCH

#### NOTES:

- ENTRANCE TOP WIDTH (W) MAY VARY FROM TWELVE (12') FEET MINIMUM TO TWENTY-FOUR (24') FEET MAXIMUM. ALL PROPOSED DRIVE WIDTHS ARE SUBJECT TO THE APPROVAL OF GOVE COUNTY ROAD AND BRIDGE SUPERVISOR.
- CULVERT SIZE MAY VARY FROM TWELVE (12") INCHES MINIMUM TO THIRTY-SIX (36") MAXIMUM DIAMETER AND SHALL BE AN APPROVED CULVERT MATERIAL AS SPECIFIED IN THE COUNTY PUBLIC RIGHT-OF-WAY USE, MAINTENANCE AND DESIGN POLICY. LARGER CULVERTS WILL BE APPROVED BY THE COUNTY ROAD AND BRIDGE SUPERVISOR.
- AT THE TIME OF CULVERT INSTALLATION, PERMITTEE SHALL CLEAN, SHAPE AND/OR GRADE EXISTING DITCHES 50 LF OR MORE IN EACH DIRECTION TO PROVIDE POSITIVE DRAINAGE.
- RECOMMENDED AGGREGATE COVER OVER CULVERT IS TWELVE (12") INCHES. IF TWELVE (12") INCHES OF COVER IS NOT ACHIEVABLE DUE TO EXISTING SITE CONDITIONS THE MINIMUM COVER THAT IS ALLOWED IS SIX (6") INCHES.
- CONSTRUCT ACCESS ENTRANCE WITH 6" OF SURFACE AGGREGATE, KDOT 1112 TYPE SS-3, SS-5, OR SS-14 AND 6" OF COMPACTED BASE AGGREGATE, KDOT 1104, TYPE AB-3, FROM EDGE OF ROAD FOR A DEPTH OF 10'. REMAINING ENTRANCE ON COUNTY PUBLIC RIGHT-OF-WAY SHALL MATCH EXISTING ENTRANCE MATERIAL.
- ACCESS ENTRANCE APPROACH AND CULVERT SHALL NOT ENCRoACH ACROSS PROPERTY LINE EXTENDED WITHOUT WRITTEN APPROVAL FROM THE ADJOINING PROPERTY OWNER.
- END SECTIONS WILL BE REQUIRED FOR ALL ACCESS ENTRANCES EXCEPT FOR FARM/FIELD ACCESS.



## SHAFER, KLINE & WARREN, INC.

216 N. Jefferson Avenue, Iola 66749-2943  
 620/365-5101 FAX: 620/365-6828

#### OFFICE LOCATIONS:

Chillicothe, MO Iola, KS Macon, MO  
 Columbia, MO Kansas City, MO North Kansas City, MO  
 Houston, TX Lenexa, KS Tulsa, OK

Designed By: DLC

Drawn By: HJP

Checked By: DLC

Issue Date: 09/2012

## ACCESS ENTRANCE AND CULVERT DETAIL